



## Technical Note

## Study of the boron homogenizing process employing an experimental low-pressure bench simulating the IRIS reactor pressurizer – Part I

Jair de Lima Bezerra<sup>a,b,\*</sup>, Carlos Alberto Brayner de Oliveira Lira<sup>a</sup>, Antonio Carlos de Oliveira Barroso<sup>c</sup>, Fernando Roberto de Andrade Lima<sup>a,b</sup>, Mário Augusto Bezerra da Silva<sup>a</sup>

<sup>a</sup> Departamento de Energia Nuclear, Centro de Tecnologia e Geociências, Universidade Federal de Pernambuco, Av. Prof. Luiz Freire, 1000, 50740-540 Recife – PE, Brazil

<sup>b</sup> Centro Regional de Ciências Nucleares do Nordeste, Comissão Nacional de Energia Nuclear, Av. Prof. Luiz Freire, 200, 50740-540 Recife – PE, Brazil

<sup>c</sup> Instituto de Pesquisas Energéticas e Nucleares, Comissão Nacional de Energia Nuclear, Av. Prof. Lineu Prestes, 2242 Cidade Universitária, 05508-900 São Paulo, Brazil

## ARTICLE INFO

## Article history:

Received 24 September 2012

Accepted 12 October 2012

Available online 28 November 2012

## Keywords:

Boron concentration

Reactivity

Image Digital Processing (PDI)

## ABSTRACT

The reactivity control of a nuclear reactor to pressurized water is made by means of controlling bars or by boron dilution in the water from the coolant of a primary circuit. The control with boron dilution has great importance, despite inserting small variations in the reactivity in the reactor, as it does not significantly affect the distribution of the neutron flux. A simplified experimental bench with a test section manufactured in transparent acrylic, was built in reduced scale as to be used in a boron homogenizing process, simulating an IRIS reactor pressurizer (International Reactor Innovative and Secure). The bench was assembled in the Centro Regional de Ciências Nucleares do Nordeste (CRCN-NE), an entity linked to the Comissão Nacional de Energia Nuclear (CNEN), Recife – PE.

© 2012 Elsevier Ltd. All rights reserved.

## 1. Introduction

A nuclear reactor in normal operational conditions has a constant potency level; in such case the neutrons production rate through radioactive fission and decay reactions must be balanced by the neutrons loss via the absorbing and escaping of the system. Any alteration in that condition will result in a temporal dependency of the neutrons population and, naturally, will change the level of the reactor potency.

In the pressurized water reactors, the so-called PWRs, the main function of the Reactor Coolant System (RCS) is to transport the thermal energy generated in the reactor to the steam generators, where this energy is transferred to the secondary system.

The pressurizer is an important component in the functioning of a PWR reactor as it controls the RCS pressure, keeping it subcooled, through electrical heaters and water spray valves. The pressurizer is a bi-phase chamber, where the steam occupies the superior part, and the liquid the inferior one. During the normal operation of a reactor, the system pressure is controlled by the pressurizer through the working of the aspersion valves and the electrical

heaters which keep the temperature of the pressurizer in a reference value.

The IRIS is a III+ generation modular reactor, refrigerated by pressurized light water, with integral configuration. The IRIS reactor project, fruit of a consortium of 20 organizations and nine countries, managed by Westinghouse, aims at meeting the four basic requisites of the reactors of the IV generation, which are: safety increase, resistance to the nuclear proliferation, reduction of costs in the electrical energy production, and nuclear waste reduction (Carrelli, 2003).

As well known, boron ( $B^{10}$ ) is an excellent absorber of thermal neutrons, and in the form of boric acid diluted in the PWR coolant reactors, it is used in the reactivity control. From the beginning of life (BOL) to the end of life (EOL) of a reactor fuel cycle, the boron concentration in the RCS is reduced as to compensate the fuel burning. The homogenizing question becomes an extremely important factor for the safety in the operation of a reactor, by reason of improper procedures in the boron homogenization. If a great amount of water with low boron concentration, below the RCS concentration, is bombed to the core, it can cause an increase in the reactor power. The opposite happens, if the water has a superior concentration of the RCS.

## 2. Theory

The accident analysis is crucial in the safety area of the nuclear centrals. From the hypothesis of accidents formulation, the behavior of the central is studied and the criteria, which determine the

\* Corresponding author at: Centro Regional de Ciências Nucleares do Nordeste, Comissão, Nacional de Energia Nuclear, Av. Prof. Luiz Freire, 200, 50740-540 Recife – PE, Brazil. Tel.: +55 81 3797 8053; fax: +55 81 3797 216150.

E-mail addresses: [jairbezerra@gmail.com](mailto:jairbezerra@gmail.com) (Jair de Lima Bezerra), [cabol@ufpe.br](mailto:cabol@ufpe.br) (Carlos Alberto Brayner de Oliveira Lira), [acobarroso@gmail.com](mailto:acobarroso@gmail.com) (Antonio Carlos de Oliveira Barroso), [falima@cnen.gov.br](mailto:falima@cnen.gov.br) (Fernando Roberto de Andrade Lima), [mabs250@gmail.com](mailto:mabs250@gmail.com) (M.A.B. da Silva).

condition for a safe operation, are established. The plants are licensed for operation with the guarantee that accidents and postulated transients do not surpass the safety limits established by technical specifications.

### 2.1. Pressurized water reactors (PWRs)

The PWR reactor, the most widely used power reactor in the world, uses light water as cooler, moderator and reflector. The main characteristic of a PWR unit is the pressured cooling water (primary circuit), always keeping a liquid phase once the pressure varies from 14 to 17 MPa.

The reactor refrigerator removes the heat generated by the core and, also, works as a moderator, reducing the neutrons energy which will produce the fissions in the fuel elements and generate heat. Besides, it also functions as a neutrons reflector, reducing their escape from the interior of the vase of the reactor and also serving as a solvent means of the boric acid which is used to aid in the control of the generation of the power in the nucleus, once it absorbs neutrons and with this, it can be used as to control the fissions reactions. In the interior of the reactor vase, the combustible elements heat the refrigerator, which remains sub-refrigerated (temperature below the saturation point, for the existing pressure), in the sequence, it is taken to the steam generators where it will transfer heat, through tubes for the feeding water which is in the interior of the GVs.

### 2.2. Pressurizer of PWR

In a PWR pressurizer, the steam and the saturated liquid coexist balanced, keeping, thus, the RCS subcooled as the temperature of the PZR is higher than the one of the RCS. The maintenance of the balance between the steam and the saturated liquid allows the control of the pressure of the RCS. The pressurizer is a vertical cylindrical vase, with the superior and inferior hemispherical lids made in carbon steel, with coating in austenitic stainless steel in all surfaces in contact with the reactor refrigerator. Electrical immersion heaters are installed in the base of the vase, while the junctions of the spray line, relief valves and safety valves are installed in the superior lid of the vase.

The pressurizer is designed as to accommodate the expansions and contractions caused by load variations. The breakout line, which leaves the base of the pressurizer, links the pressurizer to the hot leg of the primary circuit of the RCS. During volumetric expansions (due to temperature rises), the spray system, whose water comes from the cold legs of the RCS, condenses part of the existing steam in the pressurizer, avoiding that the pressure reaches the actuator value of the relief valves.

During the RCS volumetric contractions, the transformation of water into steam and the consequent steam generation by automatic action of the heaters, keep the pressure above the value in which the shutdown of the reactor, due to low pressure. The heaters are also energized when high levels of water in the pressurizer from the RCS occurs.

### 2.3. IRIS reactor

The project of an integral reactor contributes to the elimination of accidents, which doesn't happen in PWR type reactors, i.e. The IRIS is a modular pressurized water reactor with an integral configuration, all primary system components (pumps, steam generators, pressurizer and control rod drive mechanisms, are inside the reactor vessel, Fig. 1 (Carelli et al., 2004). The occurrence of Loss of Coolant Accidents – LOCA is practically eliminated, as in these types of reactors, there are no long tube systems. A safety-by-design approach, which aims at eliminating by design the possibility for an accident to occur, rather than dealing with its consequences.

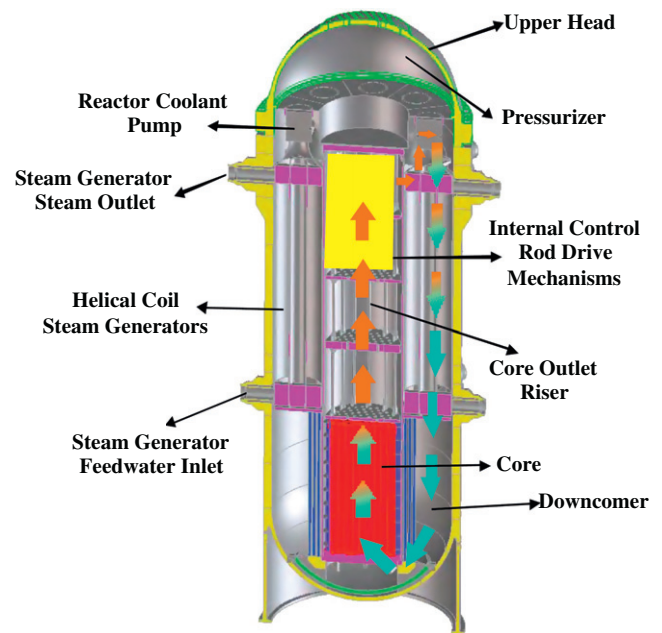


Fig. 1. Transversal cut of the IRIS reactor.

By eliminating some accidents, the corresponding safety system (passive or active) become unnecessary as well. The number and complexity of the remaining passive safety systems and of the required operator's actions are further minimized in IRIS (Barroso et al., 2003; Filho, 2011).

### 2.4. IRIS pressurizer

The IRIS pressurizer is located in the pressure vessel upper head, above the internal control rod mechanisms. As shown in Fig. 2, the pressurizer saturated water is separated from the reactor circulating, sub-cooled water, by an internal structure with an "inverted hat shape" (Barroso et al., 2003; Botelho et al., 2005). This structure eases the transfer of the heat, keeping the saturated water in the inner part of the pressurizer. Also, in the inferior part of the pressurizer, the heaters and the surges orifices are located through which water passes of the primary system.

### 2.5. Problems in the boron homogenization

Studies of transients with boron homogenizing deficiency in PWRs have been very highlighted in the last years. One solution

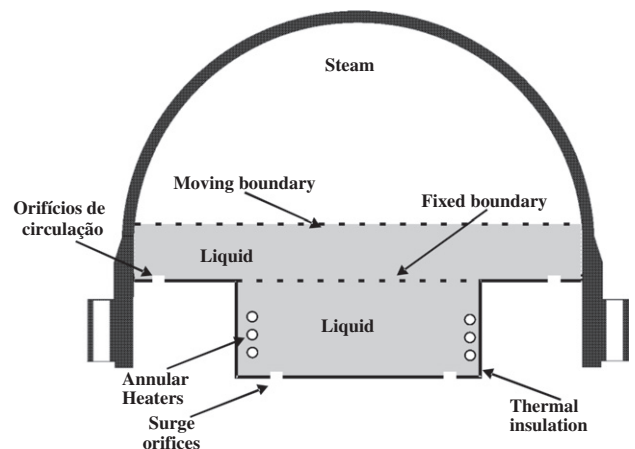


Fig. 2. Transversal cut of the IRIS pressurizer.

Download English Version:

<https://daneshyari.com/en/article/1728768>

Download Persian Version:

<https://daneshyari.com/article/1728768>

[Daneshyari.com](https://daneshyari.com)