

Use of offshore wind farms to increase seismic resilience of Nuclear Power Plants

S. Bhattacharya^{a,*}, K. Goda^b

^a University of Surrey, United Kingdom

^b University of Bristol, United Kingdom

ARTICLE INFO

Article history:

Received 30 September 2015

Accepted 1 October 2015

Keywords:

Offshore wind turbines

Nuclear Power Plant

Fukushima Nuclear Power Plant

2011 Tohoku earthquake

ABSTRACT

One of the challenges faced by the engineering profession is to meet the energy requirement of an increasingly prosperous world. Nuclear power was considered as a reliable option until the Fukushima Daiichi Nuclear Power Plant (NPP) disaster which eroded the public confidence. This short paper shows that offshore wind turbines (due to its shape and form, i.e. heavy rotating mass resting at the top of a tall tower) have long natural vibration periods (> 3.0 s) and are less susceptible to earthquake dynamics. The performance of near-shore wind turbines structures during the 2011 Tohoku earthquake is reviewed. It has been observed that they performed well. As NPPs are often sited close to the sea, it is proposed that a small wind farm capable of supplying emergency backup power along with a NPP can be a better safety system (robust and resilient system) in avoiding cascading failures and catastrophic consequences.

Crown Copyright © 2015 Published by Elsevier Ltd. All rights reserved.

1. Introduction

The world population is predicted to increase from 6 to 8 billion (i.e. 33% rise) between 2000 and 2020. Accordingly, the demand for energy is set to increase by about 60% [9]. While renewable energy sources, such as offshore marine sources (wind, wave, and tidal), onshore wind, and solar, are expanding, nuclear power is perceived to cover a significant proportion of the baseload supply. The advantage of nuclear energy is low CO₂ emission and has a proven track record to deliver reliable power in most countries. The safety philosophy is critical for designing such structures especially in seismic zones [6]. A dramatic change of the public risk perception towards nuclear energy has happened in the aftermath of the 2011 Tohoku earthquake due to the Fukushima Daiichi Nuclear Power Plant (NPP) disaster. Further details of the 2011 Tohoku earthquake can be found in Bhattacharya et al. [5] and Goda et al. [8]. In this context, it is noteworthy that India and China, which are situated in seismically active regions, are constructing NPPs to meet the increasing high energy demand.

The scope of the article is to review the effects of 2011 Tohoku earthquake on two energy systems (Fukushima NPP and near shore offshore wind farms) operating at that time to see if any lessons can be learnt to make the NPP safety system more robust and resilient.

2. Safety systems of Nuclear Power Plants (NPP)

According to the nuclear safety philosophy, buildings within a NPP are divided into safety-related and non-safety related. Safety-related building structures include reactor building, auxiliary system building, switchgear building, emergency backup generator building, or the vent stack building. The pressure vessels (for example prestressed concrete) of gas-cooled reactors and the containment buildings of PWR (Pressurised Water Reactor) and BWR (Boiling Water Reactor) are the key safety related structures. In certain design, such as BWR, the turbine building is also classified as safety-related, as radioactive live steam is fed directly into the turbine. In particular, the reactor is a critical component and the safety barrier systems consist of: (a) fuel pellets; (b) fuel rod cladding; (c) reactor pressure vessel; (d) reinforced concrete cylinder as radiation shield often known as biological shield; (e) containment; and (f) reinforced concrete shell. On the other hand, non-safety related building structures typically include administrative and workshop buildings, gatehouse, and cooling towers.

For the purpose of safety evaluation, IAEA [9] safety standards recommend that seismic input level should be considered for SL-2 (Seismic Level 2) which corresponds to an infrequent earthquake with a return period of 10,000 years (10^{-4} per year). This is considered by plant developers as a bottom-line event, i.e. the most onerous event for which the bottom-line plant provides protection. Apart from SL-2, the IAEA also recommends for SL-1 (Seismic Level 1) which corresponds to less severe and more likely earthquakes with a probability of 10^{-2} per year being exceeded.

* Corresponding author. Tel.: +44 1483 689534.

E-mail addresses: S.Bhattacharya@surrey.ac.uk, Subhamoy.Bhattacharya@gmail.com (S. Bhattacharya).

The safety philosophy in NPPs is highly redundant and essentially designed for the following three main scenarios: (a) control reactivity of the nuclear fuel, safe shut-down and reactor trip and post-trip cooling; (b) cooling fuel assemblies; and (c) controlling radioactive substances and radiation from release to the atmosphere. The safety systems are designed for internal incidents (for example, internal flooding or loss of coolant) as well as external actions (for example, floods, earthquakes, and tsunamis). To meet these safety goals, different types of active and passive safety barriers and systems are adopted where the guiding safety principles are redundancy, diversity and spatial separation. Redundancy allows the main safety systems to be replicated so that if one of the systems fails, another can take over. This corresponds to at least two lines of protection for design load case of SL-1 and at least one line of protection for SL-2. Through the diversity principle, major components of the main safety systems are made to different designs so that they don't fail at the same time due to a common cause or same reason. Finally, spatial separation ensures that major components of the redundant safety systems are spaced or located in such a way that if an incident occurs, it has no impact on the other identical redundant modules and that these modules can take over the safety function. It is of interest to review the Fukushima Daiichi NPP disaster in the light of above safety concepts.

3. Fukushima Daiichi disaster

The Fukushima Daiichi NPP consists of six BWR units in the plant and were constructed in 1970 s. The working principle is as follows: heat is generated by nuclear fission which transforms water into steam driving a turbine to generate electricity. The critical safety aspect of the whole system is avoiding the melting of the reactor and leaking of radioactive materials to the atmosphere. In this regard, one of the important safety aspect is the cooling system and during the earthquake, there was a loss of external power supply due to the combined events of ground shaking and tsunami.

The earthquake and its triggered hazards (i.e. tsunami and landslide) initiated the crisis of the Fukushima Daiichi NPP. The tsunami, which arrived around 50 min following the mainshock, was about 14 m high which overwhelmed the 6 m high sea walls and resulted in flooding the the emergency generator rooms causing

the power failure of reactor cooling systems. The loss of the cooling systems led to reactor heating up and subsequent melt-down, consequently, harmful radioactive materials were released to the environment. The power failure also meant that many of the safety control systems were not operational. The release of radioactive materials caused a large scale evacuation of over 300,000 people near the plant and the clean-up costs are estimated to be in the order of hundreds of billions of dollars.

The events leading to the triple meltdown can be described as follows:

- (1) During the 2011 Tohoku earthquake, the switching station for Reactors 1 and 2 was damaged by the shaking, whereas the transmission tower that connects the regional substation and Reactors 5 and 6 collapsed due to a landslide (note: Reactors 5 and 6 did not experience the complete loss of power because emergency generators were functional).
- (2) Additionally, after 14+ m tsunami ($M_w 9.0$ event) arrived at the plant, whereas the sea walls were only 6.5 m high (designed based on a $M_w 8.2$ event). As a result, Reactors 1–4 were inundated by the tsunami and lost the emergency diesel



Fig. 2. Photograph of the Kamisu (Hasaki) wind farm following the 2011 Tohoku earthquake.

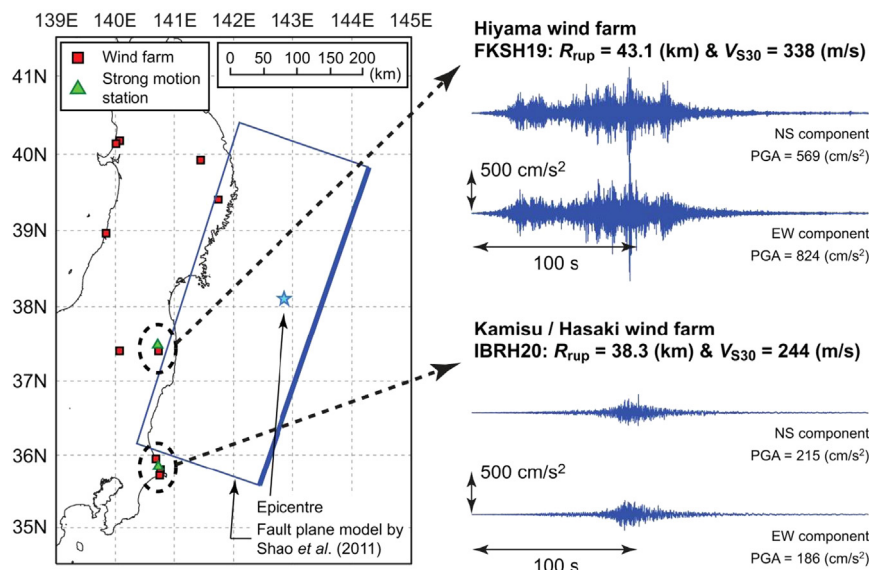


Fig. 1. Details of the 2011 Tohoku earthquake and locations of the wind farms.

Download English Version:

<https://daneshyari.com/en/article/6771703>

Download Persian Version:

<https://daneshyari.com/article/6771703>

[Daneshyari.com](https://daneshyari.com)