



Alexandria University  
**Alexandria Engineering Journal**

[www.elsevier.com/locate/aej](http://www.elsevier.com/locate/aej)  
[www.sciencedirect.com](http://www.sciencedirect.com)



ORIGINAL ARTICLE

# Fuzzy logic control of air-conditioning system in residential buildings



Abdel-Hamid Attia, Sohair F. Rezeka <sup>\*,1</sup>, Ahmed M. Saleh

*Mechanical Engineering Department, Faculty of Engineering, Alexandria 21544, Egypt*

Received 22 June 2013; revised 14 May 2014; accepted 8 March 2015

Available online 27 April 2015

## KEYWORDS

Chilled-water fan-coil;  
Residential buildings  
comfort;  
Fuzzy logic control

**Abstract** There has been a rising concern in reducing the energy consumption in building. Heating ventilation and air condition system is the biggest consumer of energy in building. In this study, fuzzy logic control of the air conditioning system of building for efficient energy operation and comfortable environment is investigated. A theoretical model of the fan coil unit (FCU) and the heat transfer between air and coolant fluid is derived. The controlled variables are the room temperature and relative humidity and control consequents are the percentage of chilled and hot water flow rates at summer and the percentage of hot water and steam injected flow rates at winter. A computer simulation has been conducted and fuzzy control results are compared with that of conventional Proportional-Integral-Derivative control. It was found that the proposed control strategy satisfies the space load and at the same time to achieve the comfort zone, as defined by the ASHRAE code. Meanwhile PID control fails to adjust the room temperature at part-load operations. It has been demonstrated that fuzzy controller operation is more efficient and consumes less energy than PID control.

© 2015 Faculty of Engineering, Alexandria University. Production and hosting by Elsevier B.V. This is an open access article under the CC BY-NC-ND license (<http://creativecommons.org/licenses/by-nc-nd/4.0/>).

## 1. Introduction

The analysis of the performance and operational strategies of HVAC systems becomes very important for the effective usage of energy [26]. The studies on the parameters of HVAC systems as temperature, volume and control strategies in the last 50 years were shown that the high performance of HVAC systems could be obtained by minimizing energy consumption. The different approaches to control systems for indoor building environments can be roughly classified into the following

categories: conventional methods, and computational Intelligence techniques, [1–18]. Soyguder et al. [1] studied the classical PID control of HVAC system having two zones with different properties. The parameters of PID were obtained to minimize the system error in their study; however, the steady-state error was not totally eliminated. Although these controllers improved the situation, improper choice of the gains in the PID controller could make the whole system unstable. Therefore, designers resorted to optimal [1–5], predictive, or adaptive control techniques [6–9]. In intelligent control systems, no mathematical model of the system is required. Recently, the practical applications of intelligent control for Heating Ventilation and Air Conditioning (HVAC) systems have been discussed with the goal being performance improvement over classical control [10–18]. The techniques include

\* Corresponding author.

<sup>1</sup> Now on leave to the Arab Academy for Science and Technology.  
Peer review under responsibility of Faculty of Engineering, Alexandria University.

### Nomenclature

$B_h$	portion of hot water valve opening, %	OS	outside air ratio
$B_s$	portion of steam valve opening, %	$Q$	coil cooling capacity, kW
$B_w$	portion of chilled water valve opening, %	$Q_R$	room cooling load, kW
$C_p, C_v$	specific heats, kJ/kg K	RLH	room latent heat, kW
$E_H$	absolute humidity error, g <sub>w</sub> /kg <sub>a</sub>	RSH	room sensible heat, kW
$E_T$	room temperature error, °C	$T$	temperature, K
$h_{fg}$	latent heat of water, kJ/kg <sub>w</sub>	$t$	temperature, °C
$h_a$	air specific enthalpy, kJ/kg	$t_{db}$	air dry-bulb temperature, °C
$K_d$	coefficient of derivative control	$t_{wb}$	air wet-bulb temperature, °C
$K_i$	coefficient of Integral control	$W_a$	humidity ratio, kg <sub>vapor</sub> /kg <sub>dry air</sub>
$K_p$	coefficient of proportional control	$\rho_a$	density of air, kg/m <sup>3</sup>
$m^o$	mass flow rate, kg/s	$\rho_w$	density of water, kg/m <sup>3</sup>
$m_{WR}$	water mass flow rate ratio, kg/s	$\tau$	time, s
$M_{ar}$	air mass flow rate ratio, kg/s		

expert systems, neural networks, fuzzy logic, and genetic algorithm.

A cooling and dehumidifying coil is an essential component of an air-conditioning system. Coil air bypass and chilled water flow control are common means for controlling space temperature in air-conditioning systems during part load operation. Many studies have been reported in the literature for the model of cooling coil [19–27]. Meanwhile, very little work is published regarding the performance of chilled water-cooling coils at part-load operations. In this case, the cooling coils suffer from significant fluctuations in their performance with large decrease in coil effectiveness.

The objective of this work was to synthesize a fuzzy-logic controller for the air conditioning system in residential buildings to control both the room temperature and humidity ratio. The performance of the proposed control is compared to that of a PID control during full and part load operations in both summer and winter.

## 2. System model

The Arab Academy Student Housing is considered as a case study for building management system. It is in Alexandria, Egypt at Latitude of 31.2. This building consists of five floors

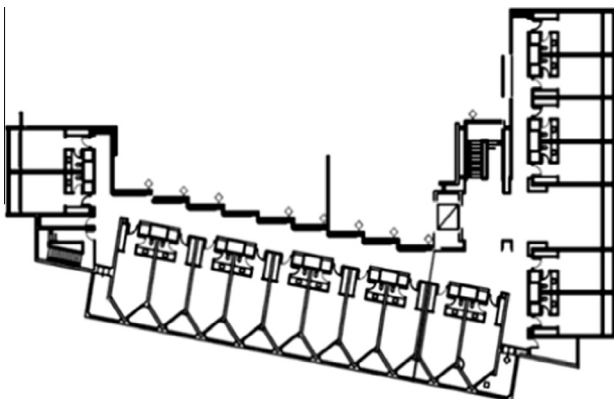


Figure 1 The five similar floors of academy building.

(zones) each floor has eighteen rooms, three paths and one hall as shown in Fig. 1. This building is similar to hotels, resorts, and banks. These buildings have zones with different setting points and sensible and heating loads. Central air-conditioning system consists of:

1. Two chillers, each has 100 ton refrigeration capacity with cooling tower to supply the cooled water to the cooling coils.
2. Boiler to supply the hot water to heating coils and to supply steam to the steam humidifier.
3. In each floor, there are 18 fan-coil units (FCU), one for each room. The fan-coil unit compact option simulates a four-pipe fan coil unit with hot-water heating-coil, chilled-water cooling-coil, and an outside-air mixer. The fan-coil units are zone equipment units which are assembled from other components. Fan coils contain an outdoor air mixer, a fan, a simple heating-coil and a cooling-coil. The fan-coil unit is connected to a hot-water loop (demand side) through its hot-water coil and to a chilled-water loop (demand side) through its cooling-coil. The unit is controlled to meet the zone heating or cooling demand as shown in Fig. 2.
4. In the addition of the FCU, there is a steam humidifier in each room to control the humidity ratio in winter.

### 2.1. Room heat balance

Rate of change of room temperature is equal to the temperature change due to the heat extracted from the space and the rate of change of temperature due to room sensible heat.

$$M \cdot C_v \cdot dT_r/d\tau = RSH - m_a \cdot C_p \cdot (T_r - T_s) \quad (1)$$

Similarly the rate of change of moisture in the room is equal to the moisture removed from the room and the room moisture load.

$$M \cdot h_{fg} \cdot dw_r/d\tau = RLH - m_a \cdot h_{fg} \cdot (w_r - w_s) \quad (2)$$

where  $M = \rho \cdot V$ ,  $T_s$  and  $w_s$  are the supply air temperature and humidity ratio, respectively.

Download English Version:

<https://daneshyari.com/en/article/816294>

Download Persian Version:

<https://daneshyari.com/article/816294>

[Daneshyari.com](https://daneshyari.com)